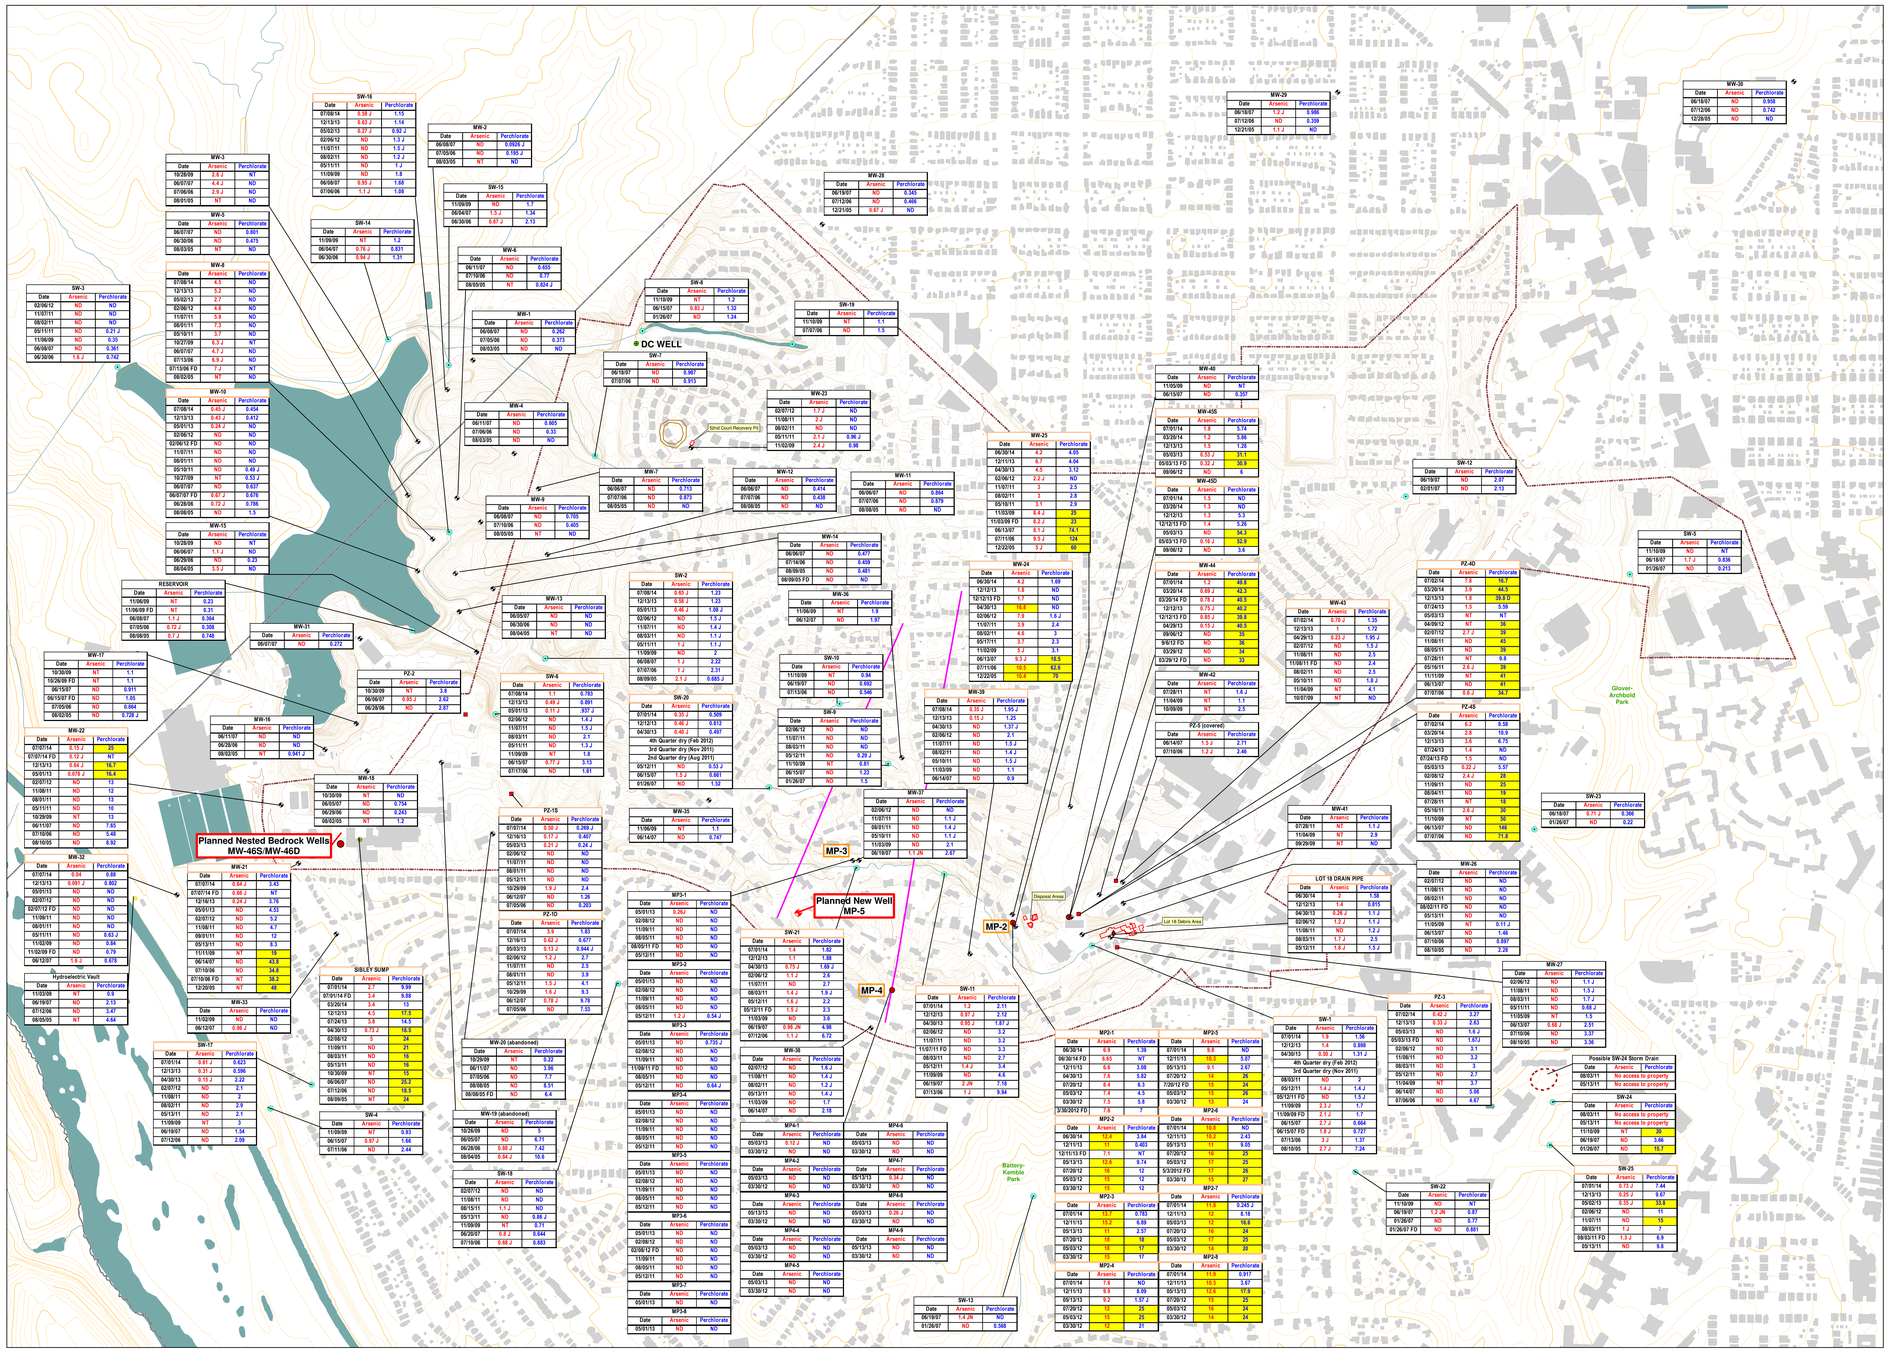

Figure 1

Water Sampling Locations/Results
Spring Valley FUDS
Washington, DC